


SECTION A-A

CONCRETE ENCASEMENT OR DUCTILE IRON PIPE WITH MJ FITTINGS IS REQUIRED WHEN CLEAR VERTICAL DISTANCE IS LESS THAN 18" OR IS LESS THAN 10' BETWEEN PARALLEL LINES

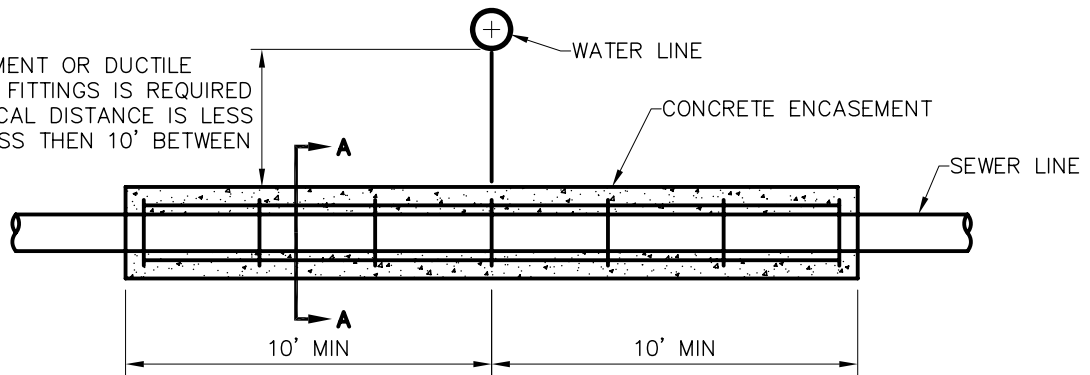

STANDARD UTILITY LINE CROSSING DETAIL

REVISION	DATE

S-311



Jones & DeMille Engineering

1535 South 100 West – Richfield, Utah 84701
 (435) 896-8266 Phone
 (435) 896-8268 Fax
 www.jonesanddemille.com

RICHFIELD CITY

SEWER – SANITARY

SCALE: NONE	ENG.: J.F.S.	PROJ.#: 0501-144
DATE: 01/21/2005	DWG.BY: L.G.	DWG.NAME: Sewer